


LEGEND

- (B) BACKFLOW PREVENTER
- (M) METER IN CHAMBER
- [M] PRIVATE METER BY OWNER
- X VALVE & BOX

NOTE 1:
PREMISE BACKFLOW PREVENTERS ON NEW INSTALLATIONS SHALL BE RP TYPE AND BE INSTALLED AS THE SERVICE ENTERS THE BUILDING BEFORE ANY CONNECTIONS OCCUR.

NOTE 2: METERING OPTIONS TO BE DECIDED BY WATER ENGINEERING ON A CASE BY CASE BASIS.


OPTION 'A'



**WINDSOR
UTILITIES
COMMISSION**

WATER SERVICING FOR MULTIPLE BUILDINGS ON ONE LOT FOR INDUSTRIAL, COMMERCIAL, INSTITUTIONAL

DRAWN BY:	CHECKED BY:	APPROVED BY:	REVISION DATE:	DWG. NO.:
	B.J.O.	N.P.	NOVEMBER 2022	50.09.01A

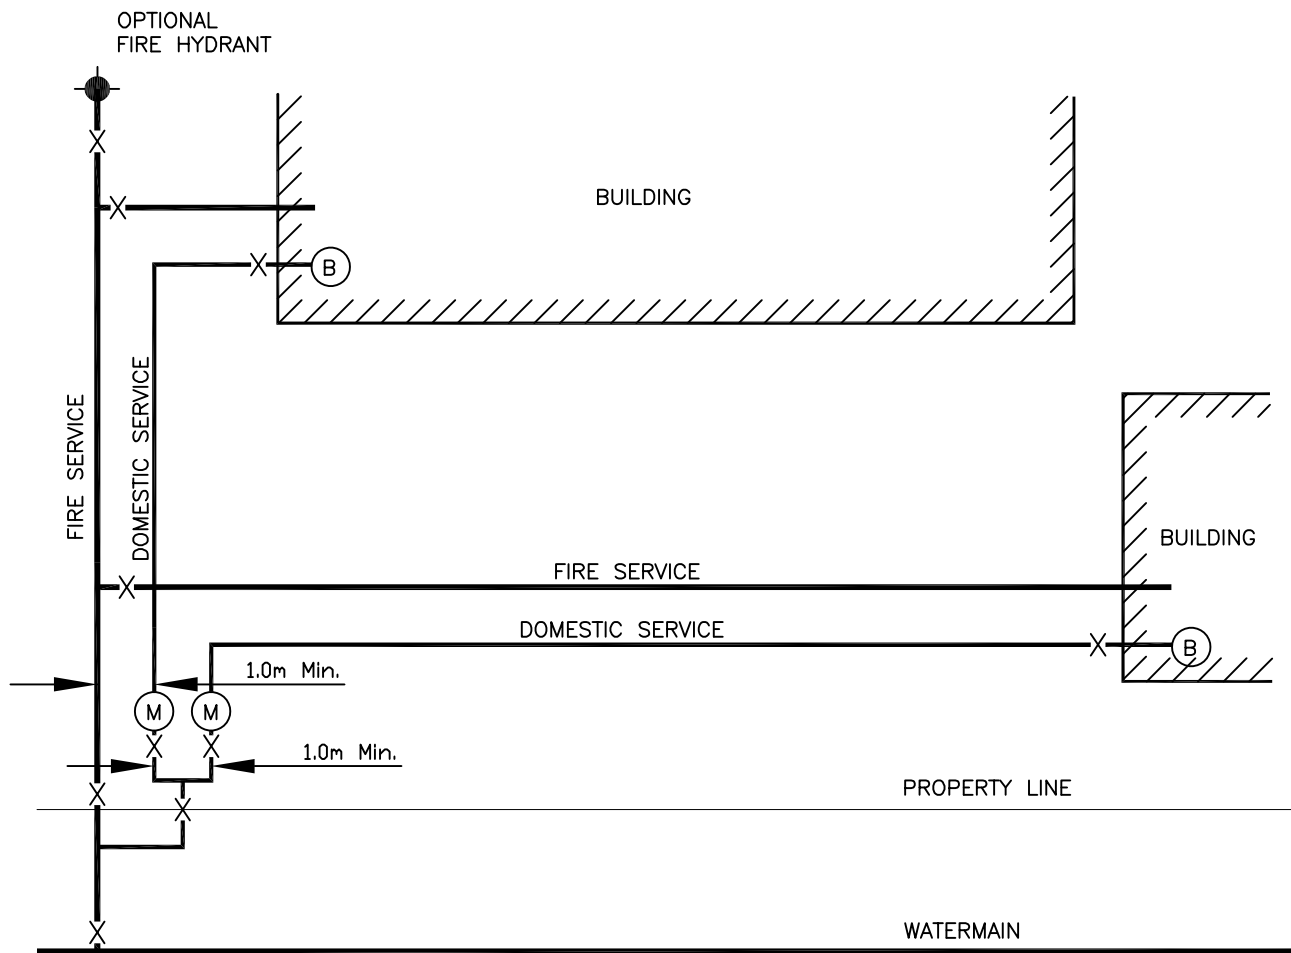

LEGEND


- (B) BACKFLOW PREVENTER
- (M) METER IN CHAMBER
- X VALVE & BOX

NOTE 1:

PREMISE BACKFLOW PREVENTERS ON NEW INSTALLATIONS SHALL BE RP TYPE AND BE INSTALLED AS THE SERVICE ENTERS THE BUILDING BEFORE ANY CONNECTIONS OCCUR.

NOTE 2: METERING OPTIONS TO BE DECIDED BY WATER ENGINEERING ON A CASE BY CASE BASIS.

OPTION 'B'



**WINDSOR
UTILITIES
COMMISSION**

WATER SERVICING FOR MULTIPLE BUILDINGS ON ONE LOT FOR INDUSTRIAL, COMMERCIAL, INSTITUTIONAL

DRAWN BY:

CHECKED BY:

APPROVED BY:

REVISION DATE:


DWG. NO.:

B.J.O.

N.P.

NOVEMBER 2022

50.09.01B

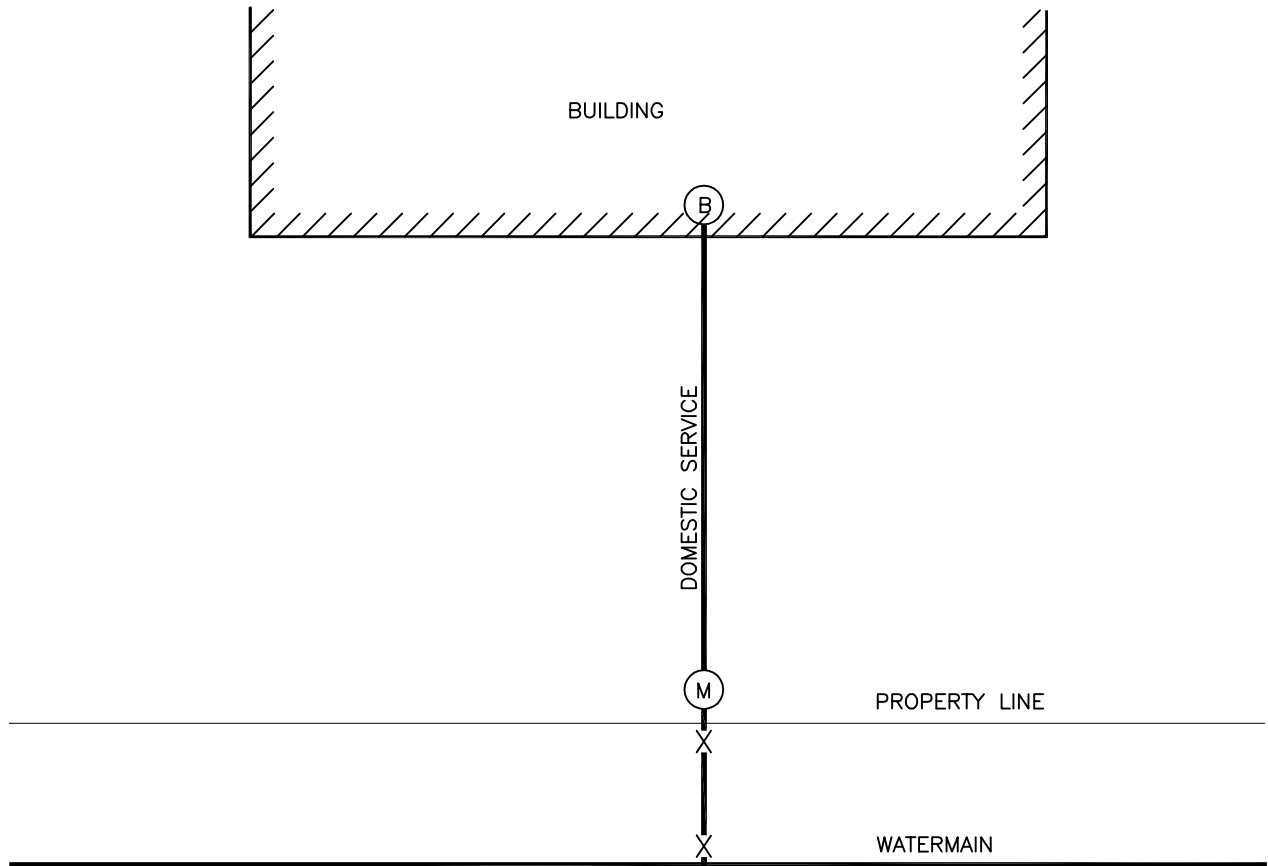


LEGEND

- ⓑ BACKFLOW PREVENTER
- Ⓜ METER IN CHAMBER
- × VALVE & BOX

NOTE:

PREMISE BACKFLOW PREVENTERS ON NEW INSTALLATIONS SHALL BE RP TYPE AND BE INSTALLED AS THE SERVICE ENTERS THE BUILDING BEFORE ANY CONNECTIONS OCCUR.



**WINDSOR
UTILITIES
COMMISSION**

DOMESTIC WATER SERVICE FOR INDUSTRIAL, COMMERCIAL, INSTITUTIONAL

DRAWN BY:

CHECKED BY:

B.J.O.

APPROVED BY:


N.P.

REVISION DATE:

MAY/2016

DWG. NO.:

50.09.02

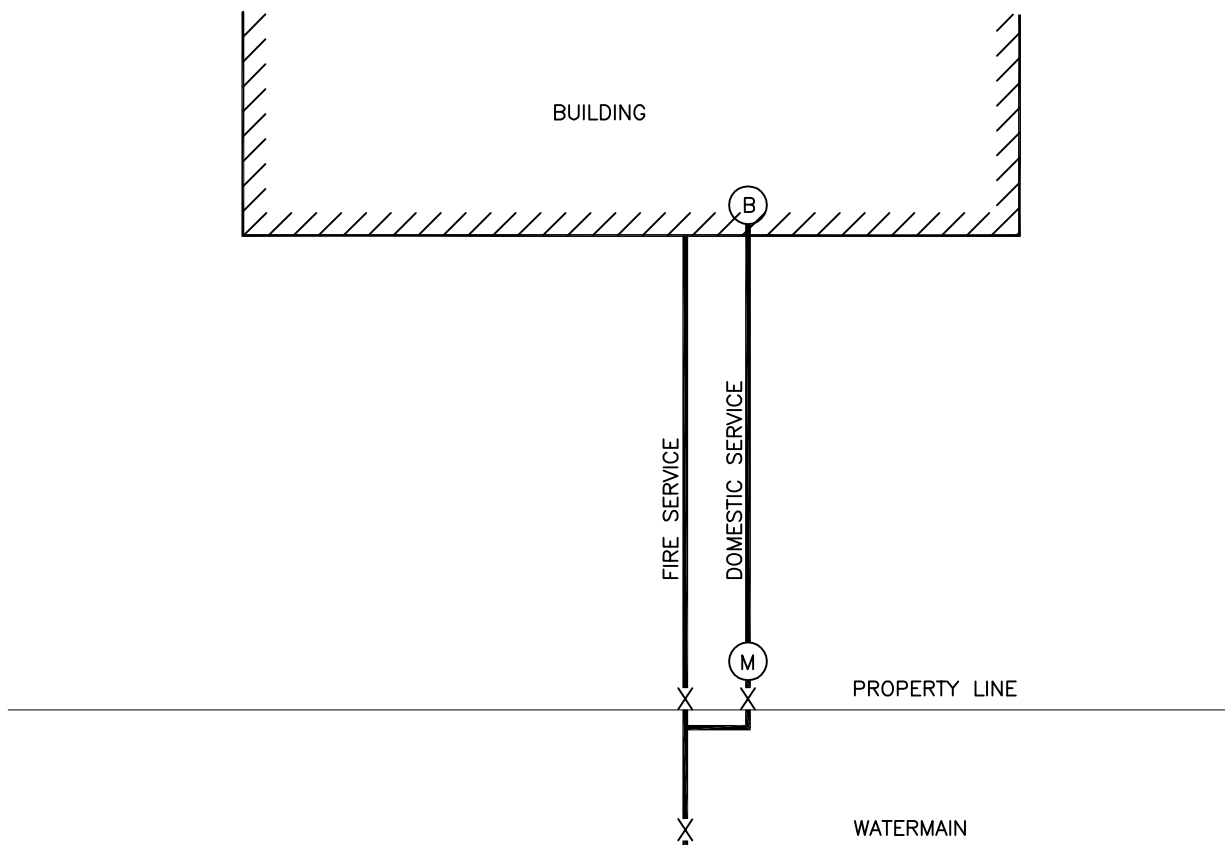


LEGEND

- ⓑ BACKFLOW PREVENTER
- Ⓜ METER IN CHAMBER
- ✕ VALVE & BOX

NOTE:

PREMISE BACKFLOW PREVENTERS ON NEW INSTALLATIONS SHALL BE RP TYPE AND BE INSTALLED AS THE SERVICE ENTERS THE BUILDING BEFORE ANY CONNECTIONS OCCUR.



**WINDSOR
UTILITIES
COMMISSION**

FIRE AND DOMESTIC WATER SERVICING FOR INDUSTRIAL, COMMERCIAL, INSTITUTIONAL

DRAWN BY:

CHECKED BY:

APPROVED BY:

REVISION DATE:


DWG. NO.:

B.J.O.

N.P.

MAY/2019


50.09.03

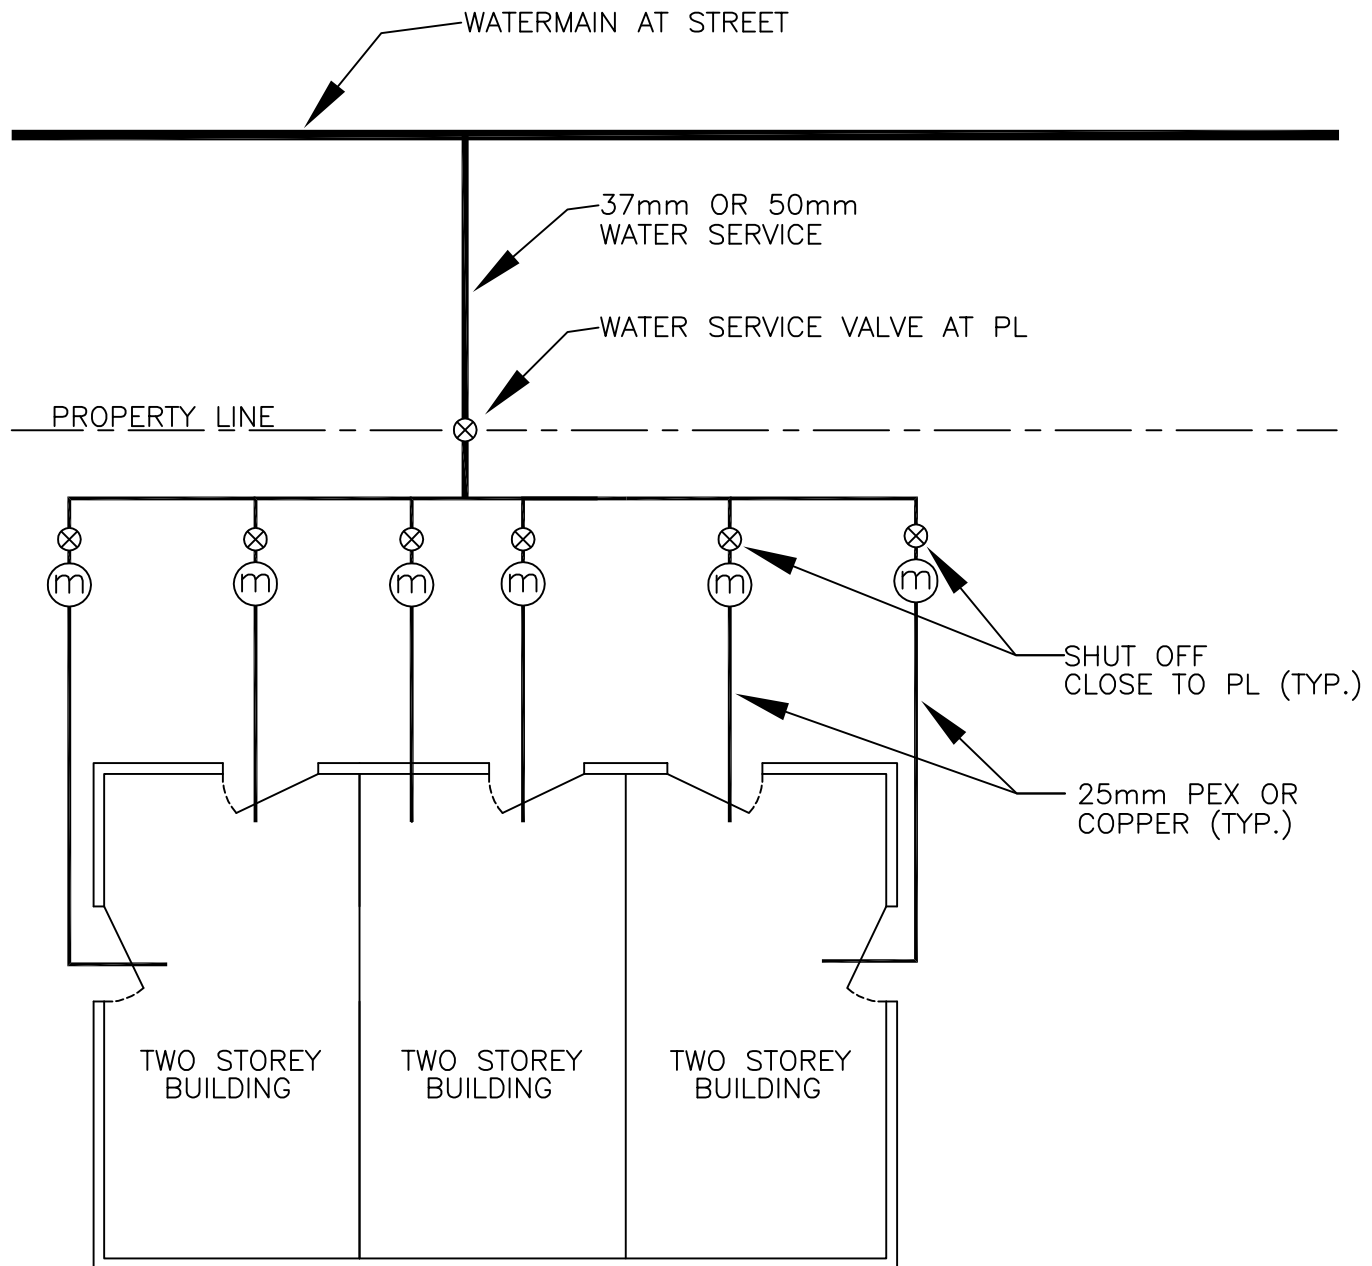

(m) METER IN A PIT

NOTE 1: METERS SHALL BE IN PITS FOR RESIDENTIAL WHEN THERE ARE NO OPTIONS FOR METERS TO BE INSTALLED IN A COMMON SPACE.

NOTE 2: METERS SHALL BE INSTALLED IN PITS FOR ALL COMMERCIAL, INDUSTRIAL, AND INSTITUTIONAL PROPERTIES.



**WINDSOR
UTILITIES
COMMISSION**

**MULTI WATER METER ARRANGEMENT MAX. 6 UNIT DEVELOPMENT
RESIDENTIAL, COMMERCIAL, INDUSTRIAL, OR INSTITUTIONAL**



DRAWN BY:
B.J.O.

CHECKED BY:

APPROVED BY:
N.P.

REVISION DATE:
NOVEMBER 2022

DWG. NO.:
50.09.04

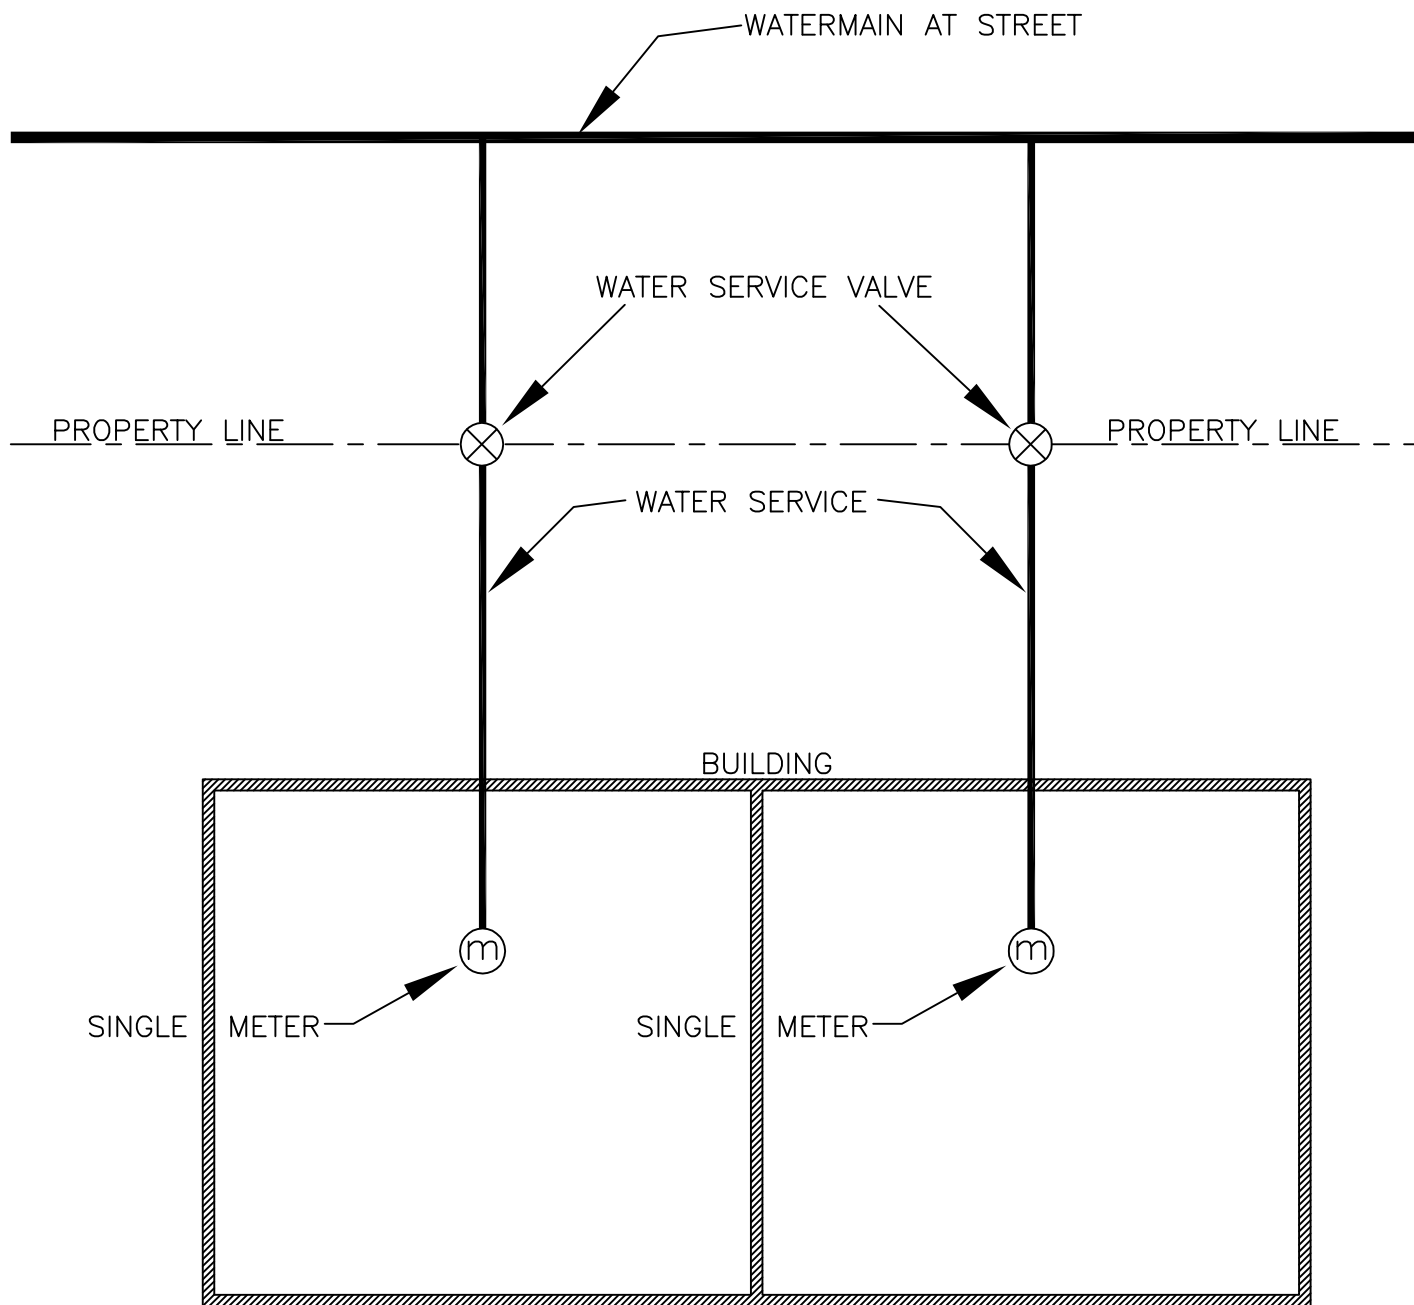

WINDSOR
UTILITIES
COMMISSION

SINGLE WATER METER ARRANGEMENT FOR SINGLE OR MULTI SINGLE RESIDENTIAL BUILDINGS

DRAWN BY:

CHECKED BY:

V.S.

APPROVED BY:


N.P.

REVISION DATE:


MARCH/2015

DWG. NO.:

50.09.05

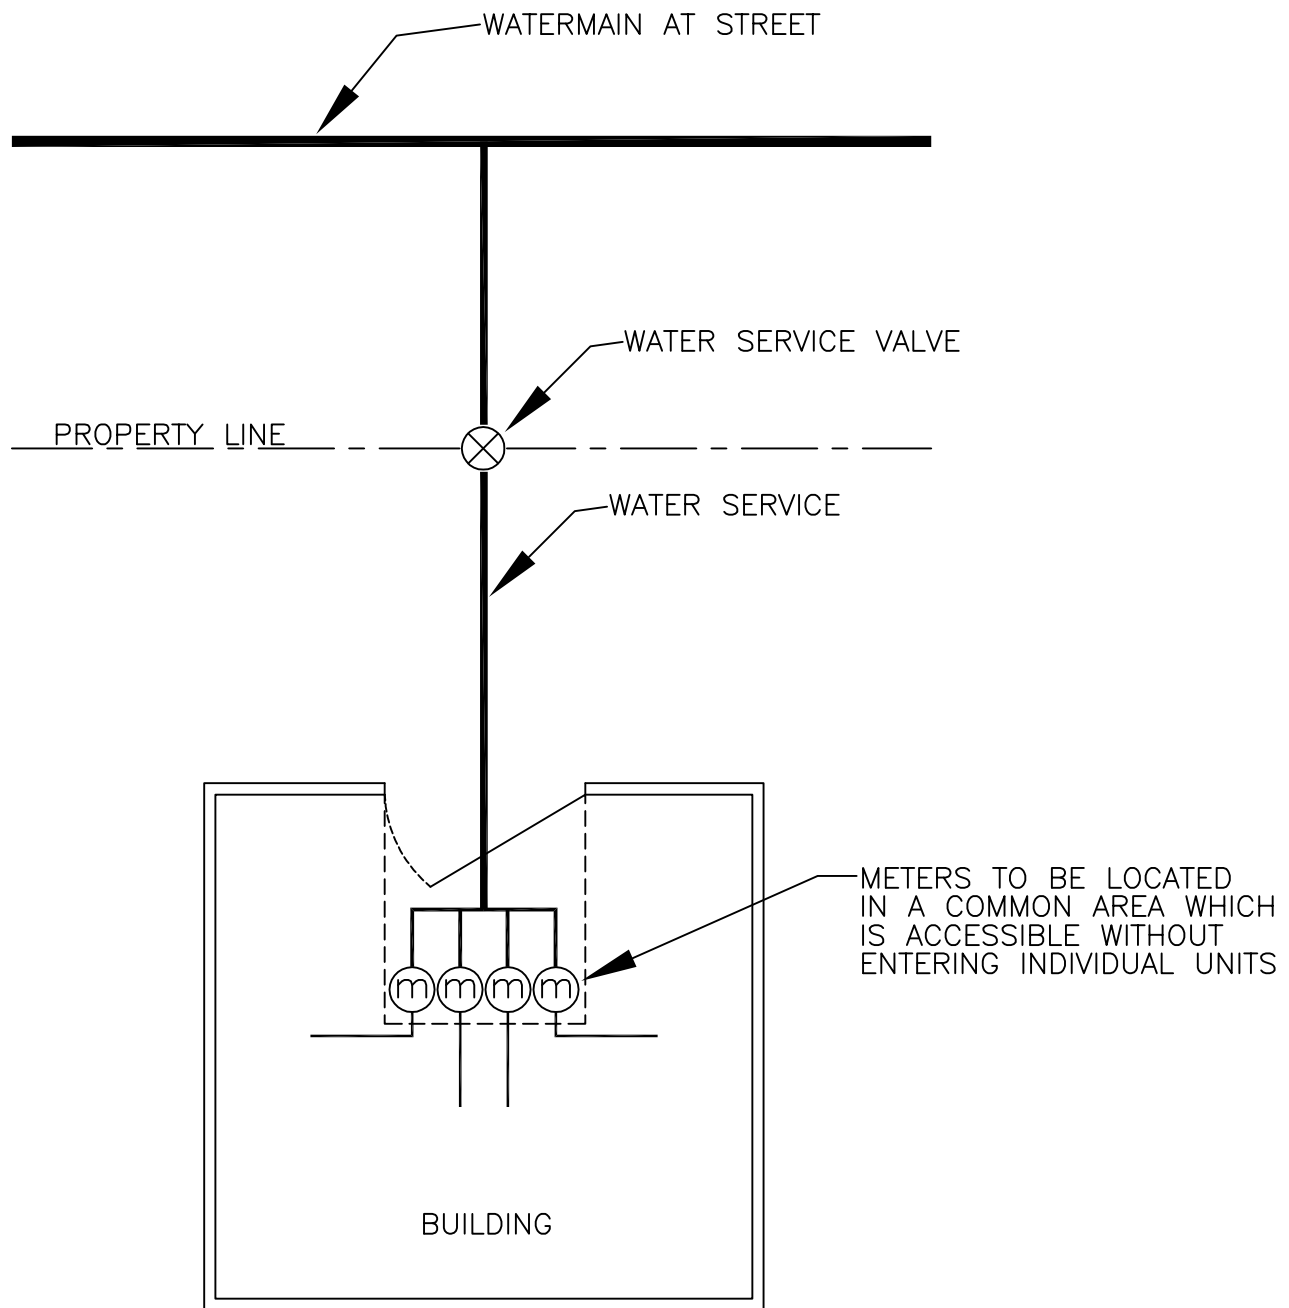

NOTE: IF NO COMMON SPACE IS AVAILABLE, THE METERS ARE TO BE INSTALLED IN PITS. SEE 50.09.04 FOR ARRANGEMENT.



**WINDSOR
UTILITIES
COMMISSION**

MULTI WATER METER ARRANGEMENT WITH METERS AT ONE LOCATION (RESIDENTIAL DUPLEX OR LARGER)

DRAWN BY:
B.J.O.

CHECKED BY:

APPROVED BY:
N.P.

REVISION DATE:
NOVEMBER 2022

DWG. NO.:
50.09.06