

# Notice of Commencement

## Municipal Class Environmental Assessment Addendum

### Central Corridor Feedermain

Windsor Utilities Commission / ENWIN Utilities Ltd.

Public Notice

#### What is the reason for an addendum?

The Windsor Utilities Commission (WUC) completed a Schedule B Municipal Class Environmental Assessment (MCEA) in 2014 to identify a preferred site for a new potable water reservoir to improve storage capacity and to identify a preferred alignment for a new central corridor feedermain. The new feedermain will improve overall operations and servicing capability to the outer limits of the existing service area. The findings and recommendations of the 2014 MCEA are documented within a project screening report.


ENWIN Utilities Ltd. (ENWIN) on behalf of WUC is currently undertaking the detail design of the project. However, based on a more detailed review of the central corridor feedermain construction approaches, modifications to the preferred feedermain alignment identified as part of the 2014 MCEA are expected. As such, an Addendum to the 2014 MCEA has been initiated to assess the potential environmental impacts associated with the changes to feedermain alignment, identify mitigation measures, and to document the changes within an Addendum report.

#### How can I provide comments?

If you have any comments, questions and/or concerns in relation to this Addendum, please contact one of the following project team members:

**Chris Manzon, P.Eng.**  
ENWIN Utilities Ltd.  
Director – Engineering (Water)  
Tel: 519 - 251-7300 ext. 295  
Email: [cmanzon@enwin.com](mailto:cmanzon@enwin.com)

**Michael Mastronardi, P. Eng**  
Stantec Consulting Ltd.  
Senior Municipal Project Manager  
Tel: 519-966-2250, ext. 250  
Email: [Michael.Mastronardi@stantec.com](mailto:Michael.Mastronardi@stantec.com)

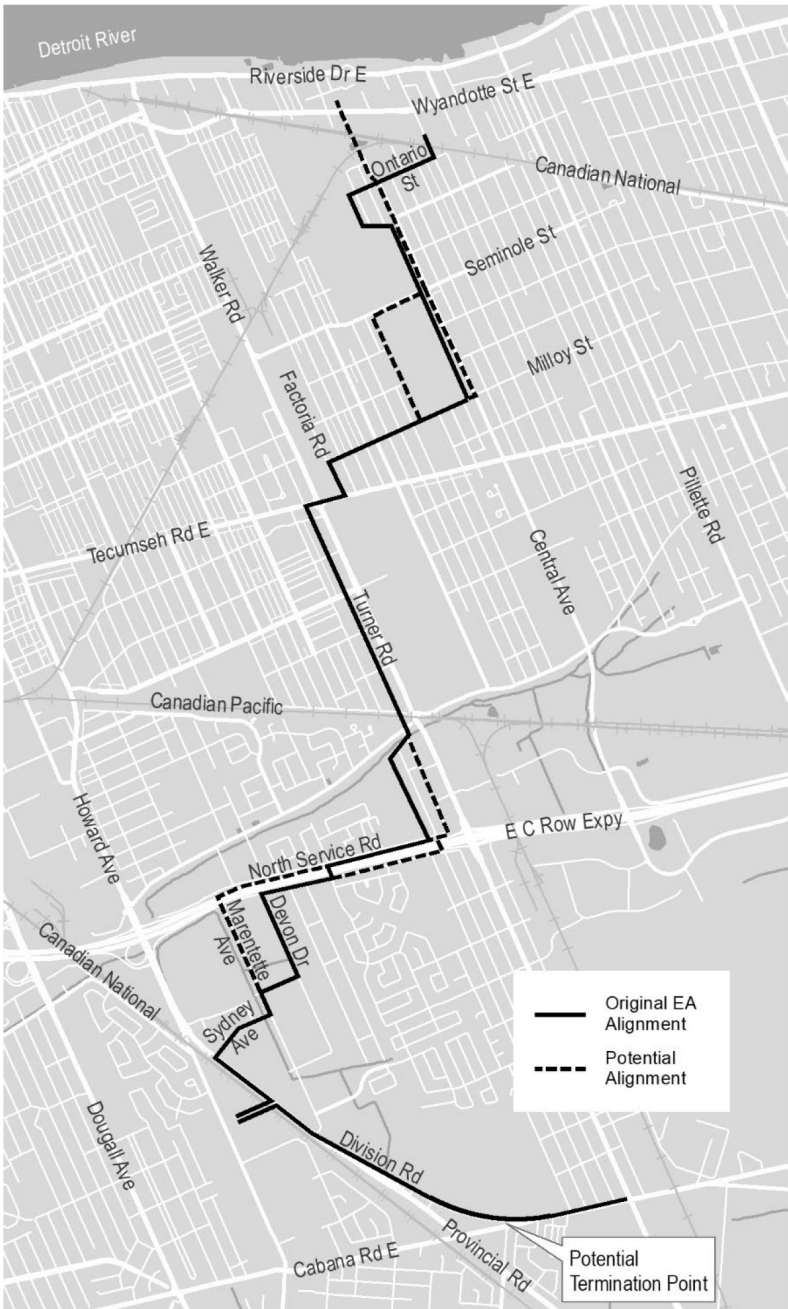

Following the completion of the Addendum report (approximately fall 2023), a Notice of Addendum will be issued to notify the public, stakeholders and Indigenous communities that the Addendum is available for review for a 30-day period. Please note that only the proposed changes to the project (i.e., feedermain alignment) will be subject to review.

Information is being collected under the *Freedom of Information and Protection of Privacy Act*. With the exception of personal information, all comments will become part of the public record.

This Notice was first issued June 28, 2023.

